

XaYýô æþ&©,•q-I P×"•*•.š

8VIBO (VJEF %SJJWF 4DJFODF BOE 5FDIOPMPHZ \$P -UE

3Ð3âö@XaYý%1]7N•I Q Bî.`-rg|A 6ûq-I 3ig|A 3i™_ .™

E Q,ö@

&©m!ö@

| 3âö@XXX HEFUFDPN

*"3•| % PÜ,wa÷{êö®

ô æþI Q <‡NjD-ˆÖ ô æþI Q •*.š| sÇ

I Q l×R]7•P×.iP¬æ²E.% .•f•`ns

d.Q9H|P× hXaYýô æþ&©,•q-I P×"•*•.š

\$PQZSJH#MIBO (VJEF %SJJWF 4DJFODF BOE 5FDIOPMPHZ \$P -UE

065 64

XaYôð æpI Q •F&wPx¨••.šæð•Fpèu qâð®ð æpI Q æ²•Fpè&Onžð®OmA 'Ôÿ(

–!<I3j a M°İlI33•<Ä{Ô%%wçe N•÷1=xA & ÷2&€/ u°ÖN•I Q &€/æ²Ný% P×XaYýð æpOý€

I Q Px¨••.š uXaYýð æp•û&m'ÔÈI Q Px¨••.š uXaYýð æp&©,•q-I Px¨••.š% <Ä;ù••

.šæ²AÜ3Ç\3'0 u|ç-ÿ u% |ç;-s¨%½÷†••.š v¨-%HeXaYýð æp&©,•q-I Px¨••.š, ,q%Ç%H°Ö


-f.i-•æ(I3nç.¨ u-;- uiÿ%ð/p|ÖOY v

ô æþ! Q %Zñ%ÇA %/, ,•-.V'ÔÊ!-,¬...4Êæ²%/,\l l², ,•-,° ,•%ð/Á uOÝ€ LéJÝxM
| uuYg|xM| >ù&m% 6ûQ•4 æ², ,q%Ç<“g .“w7•Q,Q,Sq-;6•R-ÐP°,•ÿ(&m3•%ð-, u-;6-}.)
*“[rr &ü%/Nð& -, u&€/uYg|N < -, % 'ÔÊ!-, v

*.š&3%Ä.i-•æ(u•.iæ(uN [r3Q@•8]l̃ u&ÊPÛxMl̃ u•f%/%%Q,tjA %/, ,•-,%ð/ÁI3
nġ.̀ uiY%ð u!Ď0Y.Vlè©l̃ Q PÜ,wȫ-K `ð .~ uYâZè u+ j̃ u!—™_ u&9)4ti~...4Ê~j̃ æjæ
-;6-I3OÝ€ -, uNð& -,&ü%/l3xMl̃ 'o+ NjRÆð̄-K `iY%ðLé&üuYg|xMl̃ u~k%ðuYg|xMl̃ uuY
JÝ% &i-,xMl̃ tj̃uð&m%ð/ÁI3Bĩ.̀.VPÜ,w v*•.šj̃Ď0Y.VPÜ,w| j̃ 'Ül2**3-.`3Ðæ2%ð/Á.VPÜ,w
AĩZÚB iκ%Çð .~ ulðQ~ un•Zš uBçQ, u,,~ uYâZè u+ j̃ uRðQ, u!—™_ udũ[r u!â{ð unœ
> u-,A ua÷i!tj̃•f%/ v

*.š=h% 7•NôCâqtl ÷1/Ā~O% PÛ,w÷2l3{ú†Èg|Džæ²™h•f÷1HW=©<™H“ u•rq1/%A u3QlJ
•F%1 u7*f&p™C&÷2l3R-DP&o(l'8æ²PümT÷1C ¬...°,•+Nj•æ²OÝJÝQ QhA %/æ²HW%Y% [rl3A %/
,,•-,%ð/Ā.V'o+ NjRÆK `0%÷2l3FĀÓl/p'3/æ²4 <†+â•fð«

) xM+æ°Ö.i.-i.-æ(Omô æP& , %Znç. u;- /piY%ôl3°ÖDê nmj %l[r.i.-æ.
 æ(%YJÝ+ÆR-DPæ°×XHCZ&âPÄ*)æ 3i%Q,nmj JÝ+Æu@Ziæ° pi«HCwYl3,ufl-°*
 xM| JÝ+ÆQ°*Z°N% 4 1 u ' 1 (" u " 3% D;ùxM| fîHWæ°*% 4;ùxM| <nHW%
 | <nHW,ufl-°*UI3æ°*yjiHW.V-°*UN Jz13 |)Xæ° " 3 ;ùxM| <nHWxM| l3•æ JÝ
 .i.-iæ(R u,ufl-°*UR uJÝ+ÆR uN°™_R { lW v

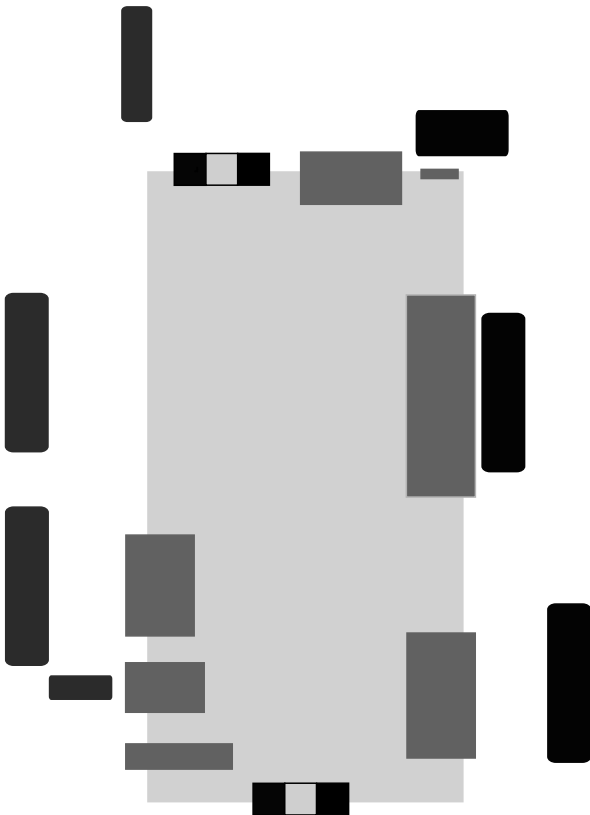

) ' 1 - \$ % # 9 9 9 9


○ ○ ○ ○ ○ ○ ○ ○ ○ ○

—	%ò/ÁxM+œ	) ' ð æÞ°Ğ°ÖDê€ nmj .i→•æ(
—	%ò/Áw74T	lùó@BóX`nmj %ò/Á 1ð@± X`nmj %ò/Á
-	N a÷C÷C	lùó@C`+Æ~ý+ - \$Yâ+
™	¬œ<¡Éj	L 7 " L 7 "
š	œ * ¼-í	, 7 , 7 , 7
›	œ +t ¼-í	, 7 , 7 , 7
œ	3Q@÷C÷C	%ó% A`€ j 3Q@÷xM  3ó@A`€ j 3Q@÷xM
*	-•*UN°™_Ÿâj	lùó@-•*UNðN°™_ #ó@*UŸâj N°™_
ž	N°™_R Ÿâj	/ Nð+ŠfR °ó@ ,•+ŠJfR .ó@H/Æ+ŠJfR
Ÿ	%ò/ÁuYg .™	lùó@NðR]÷C ó@<™H°R]÷C
	*2Ÿâ&m	lùó@Rj]+°%ò/Á *-&=ó@*2Ÿâ&mæ@ˆTQ,æ{<g•8æˆ

10kV					
	A	kW	W*D*H mm		T
HF6000-250-100/100-DB-M	14	200	2850*1350*2000	A1	2.3
HF6000-280-100/100-DB-M	16	220			2.3
HF6000-315-100/100-DB-M	18	250			2.4
HF6000-355-100/100-DB-M	20	280			2.4
HF6000-400-100/100-DB-M	23	315			2.5
HF6000-450-100/100-DB-M	26	355			2.5
HF6000-500-100/100-DB-M	29	400			2.5
HF6000-560-100/100-DB-M	32	450			2.6
HF6000-630-100/100-DB-M	36	500			2.6
HF6000-710-100/100-DB-M	41	560			2.7
HF6000-800-100/100-DB-M	46	630			2.8
HF6000-900-100/100-DB-M	52	710			2.9
HF6000-1000-100/100-DB-M	58	800			3.0
HF6000-1120-100/100-DB-M	65	900			3.1
HF6000-1250-100/100-DB-M	72	1000			3.3
HF6000-1400-100/100-DB-M	81	1120	3000*1550*2100	A2	4.7
HF6000-1600-100/100-DB-M	92	1250			4.9
HF6000-1800-100/100-DB-M	104	1400			5.1
HF6000-2000-100/100-DB-M	115	1600			5.3
HF6000-2250-100/100-DB-M	130	1800			5.5
HF6000-2500-100/100-DB-M	144	2000	4500*1350*2100	A3	5.7
HF6000-2800-100/100-DB-M	162	2250			7.4
HF6000-3000-100/100-DB-M	173	2400			7.6
HF6000-3150-100/100-DB-M	182	2500			7.8
HF6000-3500-100/100-DB-M	202	2800			8.0
HF6000-3750-100/100-DB-M	217	3000			8.2
HF6000-4000-100/100-DB-M	231	3150			8.3
HF6000-4500-100/100-DB-M	260	3550			8.5

1

0.1~1

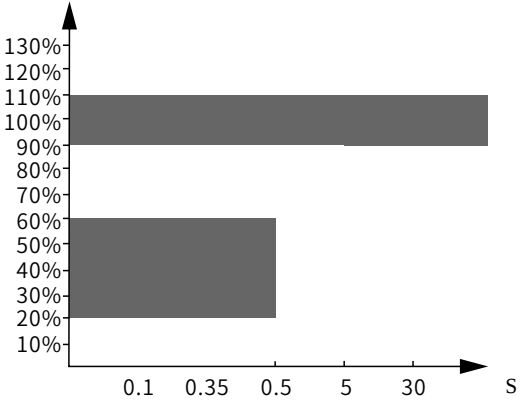

4

A A

CAN

B B

2

2

5 90% 8 92%

5

“ ” “ ”

3

6

9

380VAC1380VAC1

7

10

“ - ”10kV/6kV、50Hz10kV/6kV

10000V5776V6000V3465V

10kV6kV


8

MODBUS-RTURS485PROFIBUS


1



2

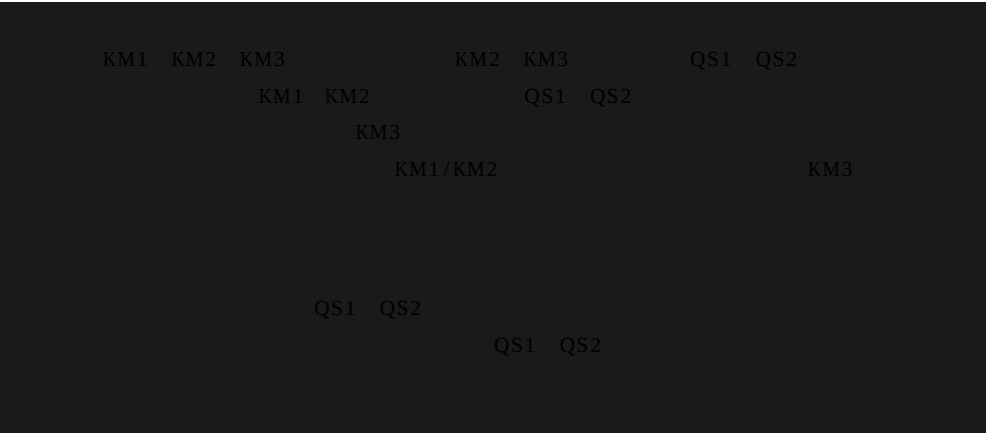

3

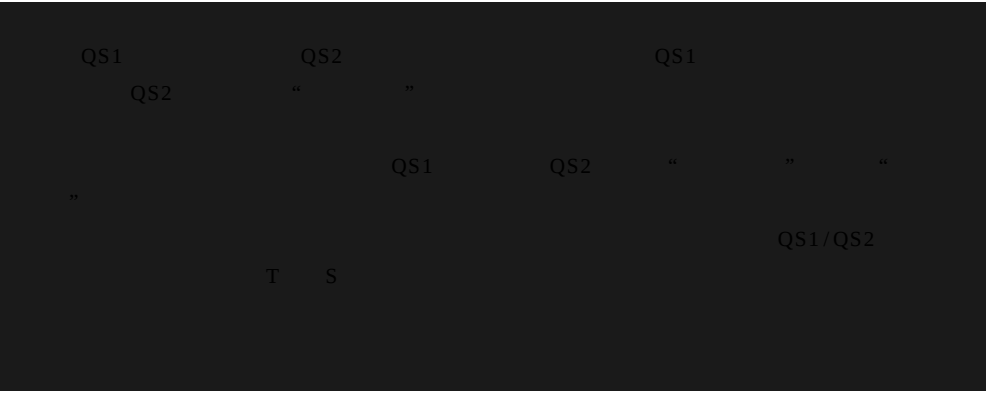

故障响应服务 24

技术支持服务

备件保障服务

30

24

40

